

***OPTION FOR 4 OR 8 LINE FXO TRUNK GATEWAY**

**** FLOWIRE IS OPTIONAL COMPONENT**

ACM-M-D-V2 CAN BE POWERED AS FOLLOWING:
 - 115VAC MAINS + 115 VAC UPS
 - 230VAC MAINS + 230 VAC UPS
 - 115 / 230 VAC MAINS + 24VDC EMERGENCY

RECOMMENDED CABLES:
 TWISTED PAIRS WITH AN OUTER ISOLATED BRAIDED SCREEN
 0,5 OR 0,75 SQ.MM CABLES

FLOWIRE:
 RECOMMEND 1,5 SQ. MM OR HIGHER. CABLE SHOULD BE SHIELDED POINT TO POINT. NONE OR FEW INTERCONNECTS ARE PREFERRED.


POWER CABLES:
 MINIMUM 1,5 SQ.MM FOR MAINS / UPS
 2,5 SQ.MM OR HIGHER FOR 24VDC EMERGENCY.

BC-12-253 CAN BE REPLACED BY OTHER APPROVED LAN SOCKET.

PUBLIC ADDRESS

ALL CALL TO PA + ALL CALL/ALARM TO ACM

OUR SPA-V2 PA/ GA SYSTEM IS A GOOD MATCH TO THIS INTERCOM EXCHANGE.

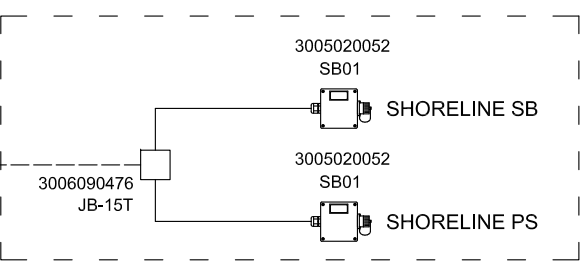

© Zenitel - All rights reserved

| Rev. | Date | Revision text | Approved | Date |
|------|------|---------------|----------|------|
| | | | | |
| | | | | |
| | | | | |
| | | | | |

| | | | | | |
|--|--|-----------|----------|-------------|----------|
| | | Prep.by | Date | Project no. | |
| | | RZ | 05.11.15 | - | |
| ACM COMMUNICATION SYSTEM Intercom exchange Type ACM-M-D-V2 O. no. 1150100002 Single line diagram | | App. by | Date | Rev. by | Rev.date |
| | | ZS | 14.01.16 | MSK | 14.01.16 |
| Dwg.no. ACM-M-D Line diagram Rev.no. 01 | | Sheet 1/1 | | Scale N/A | Size A3 |
| | | Unit MM | | | |